


1" SHORT COPPER SERVICE CURB BOX, 2'-0" IN FRONT OF SIDEWALK
 MIN. DEPTH: 54", MAX. DEPTH: 60"

* WATER MAIN WILL BE IN CENTER OF GREEN SPACE UNLESS OTHERWISE APPROVED BY THE WATER DIVISION

1" LONG COPPER SERVICE CURB BOX, 2'-0" IN FRONT OF SIDEWALK
 MIN. DEPTH: 54", MAX. DEPTH: 60"

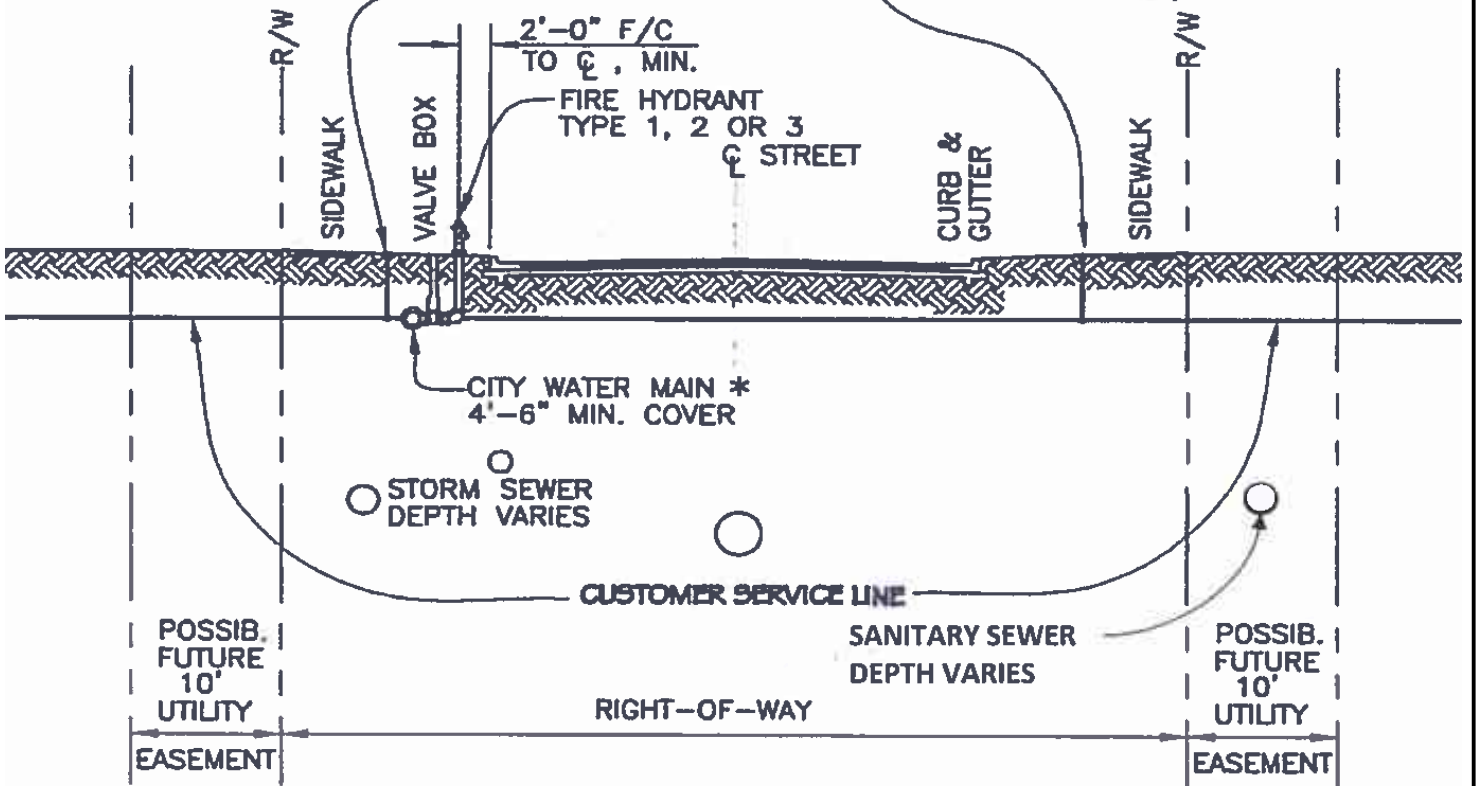

Date: 3/02/2018

Standard Construction Drawing



Typical Street Section

Drawing No.
 WTR-08