
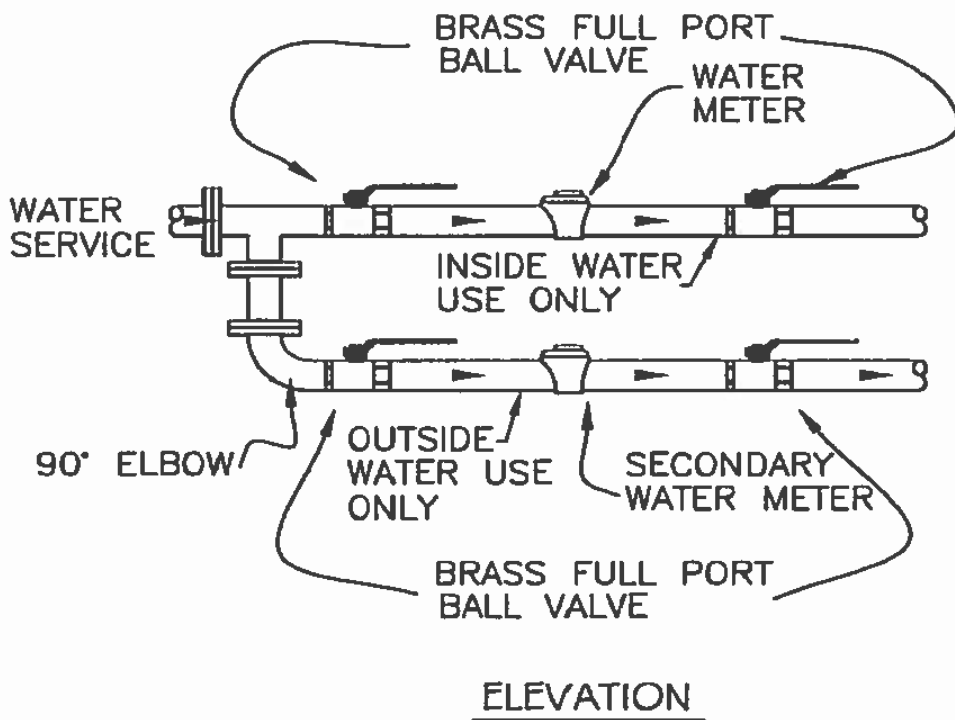
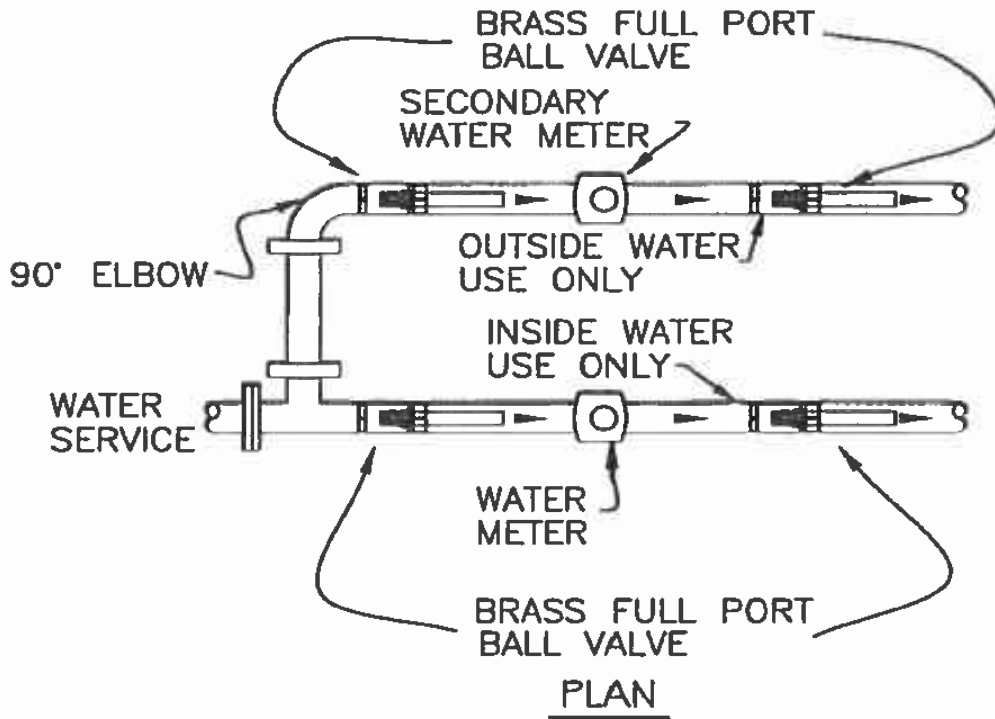


NO.	FIXTURE AND PIPE SIZE REQUIRED FOR METER	5/8" x 3/4"	1"
1	METER (TO BE SET BY MARYSVILLE DIVISION OF WATER)	5/8" x 3/4"	1"
2	BRASS INLET VALVE (FULL PORT BALL VALVE)	3/4"	1"
3	COPPER PIPING MINIMUM SIZE	1"	1"
4	METER COUPLING	3/4"	1"
5	BRASS OUTLET VALVE (FULL PORT BALL VALVE)	3/4"	1"
REQUIRED MEASUREMENTS			
A	SPACING FOR METER	7 3/4"	11"
B	MINIMUM DISTANCE - WALL TO CENTERLINE OF PIPE	4"	6"
C	MINIMUM DISTANCE - FLOOR TO CENTERLINE OF PIPE	12"	12"

Date: 3/02/2018 Standard Construction Drawing

	<p>Inside Meter Setting Requirements for 5/8" x 3/4" and 1" Meters</p>	<p>Drawing No. WTR-16</p>
--	--	--------------------------------------



NOTE: FOR EXISTING METER PITS, ALL SECONDARY METER PITS SHALL BE INSTALLED PER CITY OF MARYSVILLE STANDARDS.

Date: 3/02/2018

Standard Construction Drawing



Secondary Water
Meter Installation

Drawing No.
WTR-16A