



SECTION A-A

NOTES

1. BACKER DESIGNED FOR 3000 PSF SOIL BEARING.
2. CONCRETE BLOCK TO BE PLACED AGAINST UNDISTURBED EARTH
3. PROVIDE CLEARANCE FOR REMOVAL OF BOLTS.
4. CONCRETE BLOCK TO BE PLACED UNDER ALL FITTINGS, INCLUDING BENDS.
5. CONCRETE BLOCK TO BE 4"x8"x16" SOLIDS.
6. HARDWOOD WEDGES TO BE USED TO TAKE UP THE GAP BETWEEN BLOCKS AND FITTINGS.

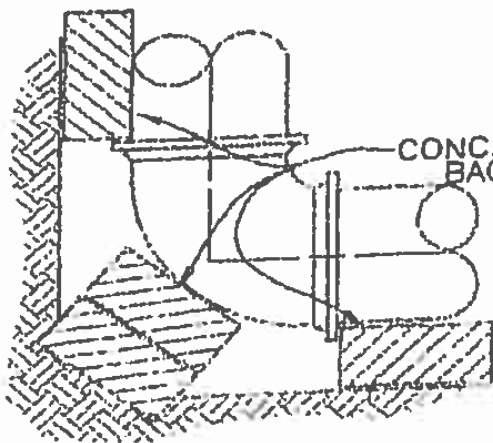

90 DEGREE BENDS

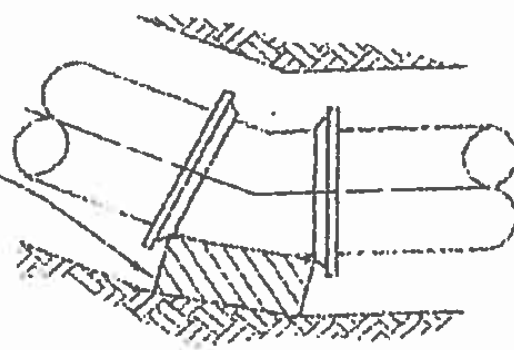

BENDS LESS THAN 90 DEGREES

Date: 3/02/2018

Standard Construction Drawing



Concrete Block Backing
for Tees & Bends

Drawing No.
WTR-18